Filtration performance down to nano-particles

FILTECH 2009
CONFERENCE PROCEEDINGS
VOLUME II

CONTENT VOLUME I

CONTENT VOLUME II

Conference Dates:
October 13 – 15, 2009

Venue:
Rhein-Main-Hallen · Rheinstr. 20 · 65028 Wiesbaden · Germany

Organizer:

Filtech Exhibitions Germany
PO Box 1225 · 40637 Meerbusch – Germany
phone: +49 (0) 2132 93 57 60
fax: +49 (0) 2132 93 57 62
e-mail: Info@Filtech.de
web: www.Filtech.de

ISBN-978-3-941655-36-2

SCIENTIFIC COMMITTEE CHAIRMEN

- **Dr. Harald Anlauf,** University of Karlsruhe, Germany
  Institute for Mechanical Process Engineering and Applied Mechanics,

- **Prof. Eberhard Schmidt,** University of Wuppertal, Germany
  Department Safety Technology / Environmental Protection

SCIENTIFIC COMMITTEE

Dr. Harald Banzhaf	Fayetteville	USA
Dr. Roger de Bruyne	Zulte	Belgium
Prof. George G. Chase	Akron	USA
Prof. José R. Coury	Sao Carlos	Brazil
Dr. Krishna Gupta	Ithaca	USA
Prof. Wilhelm Höflinger	Vienna	Austria
Prof. Kuo-Jen Hwang	Taipei	Taiwan
Prof. Eiji Iritani	Nagoya	Japan
Prof. Chikao Kanaoka	Tsubata	Japan
Prof. Gerhard Kasper	Karlsruhe	Germany
Dr. Karsten Keller	St. Louis	USA
Ir. Hermanes Kleizen	Delft	Netherlands
Prof. Gernot Krammer	Graz	Austria
Dr. Martin Lehmann	Ludwigsburg	Germany
Dr. Markus Lehner	Steinwiesen	Germany
Prof. Dietmar Lerche	Berlin	Germany
Prof. Wallace Leung	Hong Kong	P.R. China
Dr. Hisao Makino	Yokosuka	Japan
Prof. Gerd Mauschitz	Vienna	Austria
Prof. Marja Oja	Hut	Finland
Dr. Thomas Peters	Neuss	Germany
Dr. Christophe Peuchot	Foulayronnes	France
Prof. Urs Peuker	Freiberg	Germany
Dr. Jaroslav Pridal	Hradec Kralove	Czech Republic
Prof. Siegfried Ripperger	Kaiserslautern	Germany
Prof. Peter Scales	Parkville	Australia
Prof. Hans-Joachim Schmid	Paderborn	Germany
Dr. Stephen Tarleton	Loughborough	Great Britain
Prof. Hans Theliander	Gothenburg	Sweden
Prof. Kuo-Lun Tung	Taipei	Taiwan
Prof. Eugène Vorobiev	Compiegne	France
Prof. Richard Wakeman	Exeter	Great Britain
Dr. Matthias Waldenmaier	Kaiserslautern	Germany
Mr. Yan-Xi Wang	Shanghai	P.R. China
Prof. Stanislaw Wronski	Warsaw	Poland
Prof. Takeshi Yoneda	Kuwana	Japan
Prof. Yang Zhao	Hefei	P.R. China

Regions and Countries listed.

S E S S I O N S U R V E Y

Tuesday, October 13, 2009				
8.30 – 9.45	Registration			
9.45 – 11.30	Opening Session / Plenary Lecture			
11.30 – 12.15	Walk Around – Fair			
12.15 – 13.15	Lunch			
13.15 – 14.30	S1	L1	M1	G1
	Survey Lecture 1	Sedimentation Analysis in the Gravity Field	Waste Water Treatment	Air Filter I
15.00 – 16.15	S2	L2	M2	G2
	Survey Lecture 2	Sedimentation Analysis in the Centrifugal Field	Produced Water Treatment	Air Filter II
16.45 – 18.00	S3	L3	M3	G3
	Survey Lecture 3	Sedimentation and Flotation for Sorting	Combined Processes	Surface Filtration

Wednesday, October 14, 2009				
8.30 – 9.45	L4	L5	M4	G4
	Sedimentation in Centrifuges/Hydrocyclones	Poster Session I	Poster Session I	Poster Session I
9.45 – 11.00	Coffee Break - Fair	Poster Presentation	Poster Presentation	Poster Presentation
11.00 – 12.15	L6	L7	M5	G5
	Filter Media Characterization	Cake Filtration Analysis I	Deposition Control	Industrial Gas Cleaning
12.15 – 13.15	Lunch			
13.15 – 14.30	S4	L8	M6	G6
	Survey Lecture 4	Cake Filtration Analysis II	Membrane Fouling	Filter Test Systems I
15.00 – 16.15	L17	L9	M7	G7
	Depth Filtration Processes	Cake Filtration Processes I	Modelling and Simulation	Filter Test Systems II
16.45 – 18.00	L10	L11	M8	G8
	Depth Filtration Analysis I	Cake Filtration Processes II	Special Membranes	Hot Gas Cleaning

Thursday, October 15, 2009				
8.30 – 9.45	L12	L13	M9	G9
	Washing of Particles and Cleaning of Media	Poster Session II	Poster Session II	Poster Session II
9.45 – 11.00	Coffee Break – Fair	Poster Presentation	Poster Presentation	Poster Presentation
11.00 – 12.15	L14	L15	G10	G11
	Separation Enhancement by Magnetic Forces	Depth Filtration Analysis II	Monitoring and Control	Filter Media Clogging
12.15 – 13.15	Lunch			
13.15 – 14.30	S5	L16	G12	G13
	Survey Lecture 5	Separation Enhancement by Physical&Chemical Slurry Treatment	Ab- and Adsorption	Nanofibre Filter Media
15.00 – 16.15	L18	L19	G14	G15
	Backwashing Filtration Processes	Precoat Filtration	Modelling and Simulation I	Special Filter Media
16.45 – 18.00	L20	L21	G16	G17
	Filter Media Development and Application	Selective Separation and Classification	Modelling and Simulation II	Mist and Droplet Separation

Opening Ceremony	09:45 - 10:30

Plenary Lecture	10:30 - 11:30

Introduction to the characterisation of products prior to formulating a solid-liquid separation problem, Dr. Christophe Peuchot, IFTS - Institute for Filtration and Separation, France I-19

S1	Survey Lecture	13:15 - 14:30

Advances in Pore Structure Evaluation by Porometry, Dr. Krishna Gupta, Porous Materials, Inc - USA I-21

L1	Sedimentation Analysis in the Gravity Field	13:15 - 14:30

Evaluation of consolidation-sedimentation properties in batch gravity sedimentation of concentrated suspension, N. Katagiri*, T. Hashimoto, E. Iritani, Nagoya University, Japan I-95

Modeling the settling velocity of flocs using fractal geometry, A. Vahedi*, B. Gorczyca, University of Manitoba, Canada I-103

Laboratory scale evaluation of inclined settling, T. Sobisch*, D. Lerche, LUM GmbH, Germany I-112

M1	Waste Water Treatment	13:15 - 14:30

Improved treatment of secondary effluent with ultrafiltration, T. Peters*, Dr.-Ing. Peters consulting for membrane technology and environmental engineering, Germany II-477

Processing and characterization of ceramic membranes for efficient removal of lignin from bleaching effluents, M. Ebrahimi*, S. Kerker, A. Wienold, University of Applied Sciences Giessen-Friedberg; H. Neul, A. Ante, Bamag GmbH; M. Hilpert, Sappi Fine Paper Europe; P. Mund, Atech Innovations GmbH, Germany; P. Czermak, Kansas State University, USA II-485

Electro-ultrafiltration of liposomal dispersions for the removal of trace micropollutants, H. Saveyn*, M. Hakimhashemi, B. De Bock, P. Saveyn, P. Van der Meeren, Ghent University, Belgium II-491

G1	Air Filter I	13:15 - 14:30

The effect of pleat count and air velocity on the initial pressure drop and fractional efficiency of HEPA filters, I. S. Al-Attar*, E. S. Tarleton, Loughborough University; R. J. Wakeman*, Consultant Chemical Engineer, UK; A. Husain, Kuwait Institute for Scientific Research KISR, Kuwait II-19

Interaction of fluid with porous structure in filtration processes: Modelling and simulation of pleats deflection, H. Andrä, O. Iliev, M. Kabel*, Z. Lakdawala, K. Steiner, Fraunhofer Institute for Industrial Mathematics ITWM, Germany; V. Starikovicius, Vilnius Gediminas Technical University, Lithuania II-27

Importance of mechanical filtration in HVAC bags and panel air filter applications, A. Boni*, Hollingsworth & Vose Europe, Germany; J. Manns, D. Healey, S. Cox, Hollingsworth & Vose, USA II-32

S2	Survey Lecture	15:00 - 16:15

Membrane Pore Characterization Techniques - Status Quo and Future Development, Prof. Kuo-Lun Tung, Chung Yuan Christian University, Taiwan II-37

L2	Sedimentation Analysis in the Centrifugal Field	15:00 - 16:15

M2	Produced Water Treatment	15:00 - 16:15

G2	Air Filter II	15:00 - 16:15

S3	Survey Lecture	16:45 - 18:00

L3	Sedimenation and Flotation for Sorting	16:45 - 18:00

Wednesday – October 14, 2009

The comparability and optimization of different process of sludge dewatering, Y. B. Li*, J. Jin, Liaoning Provincial Environmental Protection Bureau, P.R. China I-213

M4 Poster Session I 08:30 -09:45

Effect of polymer swelling on the nanofiltration performance of poly(vinyl alcohol), O. Farid, J. P. Robinson*, University of Nottingham, UK II-542

β-Cyclodextrin-Modified polysulfone membranes for the removal of endocrine disrupting chemicals (EDCs), S. Choi*, S.-Y. Kwak, Seoul National University - Korea II-550

Preparation and characterization of aluminum oxide cermet microfiltration membrane using atmospheric plasma spraying, C.-C. Hsiung*, T.-C. Ling, K.-S. Chang, K.-L. Tung, T.-T. Wu, Y.-L. Li, C.-H. Kang, W.-Y. Chen, D. Nanda, Chung Yuan University, Taiwan II-552

Preparation and characterization of novel hydrophile low pressure nanofiltration membranes for water softening, M. Jahanshahi, A. Rahimpour*, N. Mortazavian, Babol University of Technology, Iran II-560

Nanoporous polyethersulfone membranes prepared with synthesized poly (sulfoxide-amide) as additive in the casting solution for milk filtration, A. Rahimpour*, Babol University of Technology; S. S. Madaeni, Razi University; A. Shockravi, S. Gorbani, Teacher Training University, Iran II-567

Supported lipid membrane systems for commercial aquaporin water filtration applications, J. S. Groth, M. Perry, T. Vissing, Aquaporin A/S; J. S. Hansen, J. Vogel, S. Ibragimova, C. H. Nielsen, O. Geschke, J. Emnéus, Technical University of Denmark; C. R. Hansen, Copenhagen University, Denmark II-575

Drying of transformer oil with different filter techniques, C. Glasner*, J. Robert, G. Deerberg, Fraunhofer Institute for Environmental, Safety and Energy Technology UMSICHT, Germany II-579

Immobilization of fungal laccase on membrane and its use for decolorization of dye, N. Katagiri*, Y. Ogi, E. Iritani, Nagoya University, Japan II-587

Membrane bioreactor with submerged ceramic flat membranes for the production of organic acids, T. Hahn*, Z. Kovacs, I. Hannemann, K. Grau, University of Applied Sciences Giessen-Friedberg; H. J. Schmidt, Membrane Engineering GmbH; M. Kraume, Technical Universtity Berlin, Germany; P. Czermak, Kansas State University, USA II-594

Long term experiences using microfiltration membranes for separation of bacterial biomass in recirculating aquaculture system, A. Gerbeth*, B. Gemende, N. Pausch, M. Schwind, University of Applied Sciences Zwickau; A. von Bresinsky, Fischwirtschaftsbetrieb Andreas von Bresinsky; R.-P. Busse, Busse GmbH, Germany II-600

Research & development in microfiltration technology (MF) at KISR, A. Alsaffar*, S. Bou-Hamad, A. Alsairafi, M. Alshimmiri, H. Alnaser, Kuwait Institute for Scientific Research, Kuwait II-607

G4 Poster Session I 08:30 -09:45

Simulation of DPF media, soot deposition and pressure drop evolution, K. Schmidt*, S. Rief, A. Wiegmann, Fraunhofer Institute for Industrial Mathematics ITWM, S. Ripperger, Germany II-74

M5 Deposition Control 11:00 - 12:15

Improved deposition control for membrane bioreactors with immersed flat sheet membrane modules, H. Prieske, L. Böhm*, A. Drews, M. Kraume, Technical Universtity Berlin, Germany II-615

Effects of water quality and antiscalants on silica scaling of reverse osmosis membranes, W. Hater, C. zum Kolk, P. Izquierdo, BKG Water Solutions; G. Braun*, T. Götz, C. Espendiller, Cologne University of Applied Sciences, Germany II-623

Particle deposition in rotating filter disks, Y. Taamneh*, Tafila Technical University, Jordan; L. Steinke, S. Ripperger, University of Kaiserslautern, Germany II-640

G5 Industrial Gas Cleaning 11:00 - 12:15

Enhanced energy efficiency solutions for industrial baghouse filters, G.-M. Klein*, T. Schrooten, T. Neuhaus, R. Esser, F. Ott, T. Daniel, Intensiv-Filter GmbH & Co. KG, Germany II-144

Conical lamina filter elements for higher filtration and energy efficiency and micro-fiber membrane filter media, K. Schumann*, Schumann Kompaktfilter, Germany II-152

Improved performance of bag filters through fabric surface modification, A. K. Choudhary*, A. Mukhopadhyay, National Institute of Technology, India II-157

S4 Survey Lecture 13:15 - 14:30

Development history and system integration aspects of diesel particle filters in commercial vehicles, Dr. Achim Dittler, Daimler AG, Germany I-64

L8 Cake Filtration Analysis II 13:15 - 14:30

Constant pressure filtration of fibre/particle mixtures, K. Chellappah*, E. S. Tarleton, R. J. Wakeman, Loughborough University, UK I-260

Multi-staged creep effect in consolidation of tofu and okara as soft colloids, E. Iritani*, T. Sato, N. Katagiri, Nagoya University, Japan I-268

Filtration-consolidation analysis of solid/liquid expression from biological tissue, N. Grimi*, E. Vorobiev, Technical University of Compiègne, France; N. Lebovka, National Academy of Sciences of Ukraine, Ukraine; J. Vaxelaire, University of Pau and Pays de l'Adour, France I-276

M6 Membrane Fouling 13:15 - 14:30

Use of surface interaction free energy in the prediction of organic fouling of reverse osmosis (RO) membrane, R. Bai*, J. Miao, C. Liu, P. Tay, National University of Singapore, Singapore II-638

Fouling transition in high molecular weight flexible polymer cross-flow ultrafiltration, L. Béguin*, IFTS Institute of Filtration and Techniques of Separation; H. Duval, M. Rakib, Ecole Centrale Paris, France II-646

Effect of air-sparging on the performance of cross-flow microfiltration of yeast suspension, K.-J. Hwang*, C.-E. Hsu, P.-Y. Si, Tamkang University, Taiwan II-654

G6 Filter Test Systems I 13:15 - 14:30

Comparison of differently generated soots used for filter testing, S. Haep*, H. Fissan, H. Kaminski, C. Asbach, B. Stahlmecke, H. Finger, Institute of Energy and Environmental Technology (IUTA), Germany II-165

Filtration of nanoparticles: presentation of FANA test bench, N. Michielsen*, T. Lelandais, C. Brochot, S. Bondiguel, IRSN Institute for Radiological Protection and Nuclear Safety, France II-172

Portable filtertester for nanometer and micrometer sized particles - the new all in one solution, leightweight no consumeables, no emissions, F. Schneider, R. Hagler, M. Pesch, Grimm Aerosoltechnik GmbH, Germany II-178

L17 Depth Filtration Processes 15:00 - 16:15

The difficulty with filtering gel particles when producing man-made fibers and optical films, S. Strasser*, K. Brandt, Lenzing Technik GmbH, Austria I-479

Development and characteristics of a new ion exchange filter cartridge made of phosphorylized hemp fibre yarn, B. Gemende*, N. Pausch, H. Mueller, A. Gerbeth, University of Applied Sciences Zwickau; M. Leiker, Produktions- und Umweltservice GmbH; J. Hofmann, U. Freier, K. König, Universität Leipzig; M. Feustel, A. Richter, Textilforschungsinstitut Thüringen-Vogtland e.V., Greiz, Germany I-486

Media for water separation from biodiesel-ultra low sulfur diesel blends - comparision with super absorbant monitor media, C. M. Stanfel*, F. Diani Pangestu, Ahlstrom Filtration, LLC, USA I-494

L9 Cake Filtration Processes I 15:00 - 16:15

Experimental study on the influence of process variables on the performance of a horizontal belt filter, M. Huhtanen*, A. Häkkinen, J. Kallas, Lappeenranta University of Technology; B. Ekberg, Larox Corporation, Finland I-284

Design of a new high performance drum filter for the chemical industry, T. Langeloh, Bokela GmbH, Germany I-292

Plate and frame pressure filter optimisation using plant load cell data: Advantages, challenges and outcomes, R. G. de Kretser*, H. Saha, C. Biscombe, P. J. Scales, University of Melbourne, Australia I-300

M7 Modelling and Simulation 15:00 - 16:15

Modeling of enzymatic synthesis of fructooligosaccarides in continous membrane reactors, Z. Kovacs*, L. Engel, K. Grau, T. Hahn, M. Ebrahimi, University of Applied Sciences Giessen-Friedberg, Germany; P. Czermak, Kansas State University, USA II-669

Modelling the separation of protein solutions by means of cross flow filtration, T. Grein*, S. Ripperger, University of Kaiserslautern; A. Piry, W. Kühnl, U. Kulozik, Munich University, Germany II-678

3D reconstruction of ultrafiltration cakes from binarised images, F. Courteille, F. Bourgeois*, M. Clifton, M. Meireles, Laboratoire de Génie Chimique UMR 5503, France II-686

G7 Filter Test Systems II 15:00 - 16:15

Filtration performance down to nano-particles, P. Tronville*, Politecnico di Torino, Italy; R. Vijayakumar, AERFIL LLC, USA II-183

Essential improvements for a reliable fractional efficiency testing of air filters, M. Schmidt*, L. Mölter, Palas® GmbH, Germany II-191

Investigation of the filtration behaviour of an artificial filtration test rig in comparison to an industrial filter unit – Differences and possibilities of scale up, G. Gasparin*, Evonik Fibres GmbH, Austria II-199

L10 Depth Filtration Analysis I 16:45 - 18:00

Advanced fibrous media simulations based on 3D structural data of real filter media, M. J. Lehmann*, S. Hiel, E. Nißler, P. Trautmann, MANN+HUMMEL GmbH, Germany I-308

Analysis of the behaviour of an automotive fuel filter using a Brinkman-Darcy approximation and a probability density function for the two-phase flow, L. Valiño, R. Mustata, J. Hierro, Laboratorio de Investigación en Tecnologías de la Combustión, J. L. Hernández*, C. Blasco, Robert Bosch España Gasoline Systems S.A., Spain I-316

On coupled particle level and filter element level simulation for filtration processes, Z. Lakdawala*, O. Iliev, S. Rief, A. Wiegmann, Fraunhofer Institute for Industrial Mathematics ITWM, Germany I-324

L11 Cake Filtration Processes II 16:45 - 18:00

Ultra-fine coal dewatering with hyperbaric disc filters, G. Krammer*, J. Kappel, R. Raberger, Andritz AG, Austria I-329

Saving of wash liquid at filtration, R. Bott*, T. Langeloh, Bokela GmbH, Germany I-337

Secondary-Dewatering of solid-liquid separation in sodium bi-carbonate separation applications, D.-E. Keller*, KMPT AG, Germany I-345

M8 Special Membranes 16:45 - 18:00

Catalyst crosslinked membranes for use in solvent resistant nanofiltration, K. T. Cliff*, S. Tarleton, Loughborough University, UK II-678

Optimization of the channel form geometry of porous ReSiC ceramic membrane modules, S. Alexopoulos*, G. Breitbach, B. Hoffschmidt, University of Applied Sciences Aachen, Germany II-686

Textiles for the filtration of activated sludge in membrane bioreactors (MBRs), L. Böhm*, V. Iversen, S. Hermann, A. Drews, J. Münz, M. Kraume, TU Berlin, Germany; E. Fatarella, Next Technology Tecnotessile, Società Nazionale di Ricerca Tecnologica r.l., Italy; B. Lesjean, Berlin Centre of Competence for Water, Germany II-694

G8 Hot Gas Cleaning 16:45 - 18:00

Use of CFD-software with simulation of particle formation and precipitation in high temperature processes, T. van der Zwaag*, C. Asbach, S. Haep, Institute of Energy and Environmental Technology IUTA; E. Kruis, University of Duisburg-Essen; K. Reuter-Hack, Karlsruhe University, Germany II-205

Evaluation of filtration and recleaning performance of hot gas filter media, R. Mai*, H. Leibold, H. Seifert, Forschungszentrum Karlsruhe GmbH, P. Gäng, Fil T Eq GmbH, Germany II-213

High Temperature Filtration of Pyrolysis Gases from Biogenic Feedstocks, H. Leibold*, R. Mai, J. Sitzmann, H. Seifert, Forschungszentrum Karlsruhe GmbH, Germany; A. Hornung, Aston University, UK; Y. Solantausta, VTT, Finland II-219

Thursday – October 15, 2009

L12 Washing of Particles and Cleaning of Media 08:30 - 09:45

Flushing – Cleaning of debris and filter cakes from organic solvents, M. Wilkens*, U. A. Peuker, Technical University Bergakademie Freiberg, Germany I-350

The impact of centrifugal force on the quality of cake washing, F. Ruslim*, A. Erk, T. Danner, BASF SE, Germany I-357

Dissolution of magnetite particles in acidic conditions, R. Salmimies*, A. Häkkinen, J. Kallas, Lappeenranta University of Technology; B. Ekberg, Larox Corporation, Finland I-362

L13 Poster Session II 08:30 -09:45

· Washing of Particles ·

Influence of experimental parameters on local and filtrate properties of kraft pulp displacement washing, K. Dingwell*, J. Lindau, M. Sedin, H. Theliander, Chalmers University of Technology, Sweden I-370

· Backwashing Filtration Processes ·

Enhancing classical effluent treatment plant efficiency by introducing BASP rotary wedge wire drum dewatering screens, B. Patil*, V. Patil, BASP Industries, India I-378

Precious metal catalyst recovery in API processing, L. Vashishta, Diva Envitec Europe Ltd., Great Britain; D. Stöcker, GKN Sinter Metal Filters GmbH, Germany I-386

· Depth Filtration Processes ·

Effects of Biodiesel By-Products on Interfacial Tension and Water Separation Properties of Biodiesel-Ultra Low Sulfur Diesel Blends, F. D. Pangestu*, C. M. Stanfel, Ahlstrom Filtration, LLC, USA I-394

· Chromatography ·

Preparative separation and purification of plasmid DNA nano-vectors using anion exchange expanded bed chromatography, M. Ebrahimpour, M. Jahanshahi*, Babol University of Technology, Iran I-396

· Electrocoagulation ·

Removal of arsenic from wastewaters by batch airlift electrocoagulation, H. K. Hansen*, P. Nuñez, C. Guiterrez, L. M. Ottosen, Technical University Federico Santa Maria, Chile I-404

· Filter Media ·

Choice and optimization of technical woven wire meshes in the solid liquid separation, M. Knefel, P. Wirtz, GKD - Gebr. Kufferath AG, Germany I-585

M9 Poster Session II 08:30 -09:45

Liquid-Liquid extraction of ammonia using hollow fiber membrane contactors, M. Ulbricht*, J. Schneider, M. Stasiak, Membrana GmbH, Germany; J. Munoz, A. Sengupta, B. Kitteringham, Membrana Charlotte, USA II-702

Achieving cleaner solutions, H. Williams*, Serfilco International, Great Britain; J. H. Berg, Serfilco Ltd, USA II-709

Development and large scale testing of water reuse process technologies in waste water free houses and companies based on ultrafiltration membranes of Microdyn-Nadir, A. Huber*, SCAUT Forschungsgesellschaft mbH; D. Swaboda, GFI GmbH, Germany II-712

Purification and recycling of water at a food-processing plant based on the example of natural sausage casing production using a physical-chemical-biological system with ultrafiltration membranes from Microdyn-Nadir, A. Huber*, SCAUT Forschungsgesellschaft mbH, Germany II-720

Integrated membrane process for treating desulfurization effluent, N. Yin*, F. Liu, Z. Zhong, W. Xing, Nanjing University, P. R. China II-728

Recycle effect on double-pass concentric circular mass exchanger with an idealized membrane inserted, C.-D. Ho*, J.-W. Tu, Y.-C. Chuang, Tamkang University, Taiwan II-732

Organic solvent nanofiltration in the pharmaceutical industry, H. Beckers, A. Buekenhoudt, P. Vandezande, R. Vleeschouwers*, VITO, Belgium II-739

G9 Poster Session II 08:30 -09:45

Penetration of aerosol particles through polydisperse fibrous filters – Model and experiment, A. Podgórski*, A. Jackiewicz, Warsaw University of Technology, Poland II-406

G15 Special Filter Media 15:00-16:15

Nano filtration media - Challenges of modelling and computer simulation, L. Cheng*, S. Rief, Fraunhofer Institute for Industrial Mathematics ITWM, Germany II-413

Investigation of filter service life increased by collating high efficiency media, P. P. Tsai*, The University of Tennessee, USA II-420

High-performance spunlace filter media for process air and liquid filtration, V. Lorentz*, Norafin GmbH, Switzerland II-429

L20 Filter Media Development and Application 16:45-18:00

Influence of filter cloth behaviour on the layout of cake forming filters, E. Ehrfeld, Bokela GmbH, Germany I-542

Comparison of pore size distribution of non-woven fibrous filter evaluated by computer simulation with the distributions measured by DFM and microscopic observation, K. Matsumoto*, K. Nakamura, Yokohama National University; T. Yunoki, Tritec Corporation, Japan I-550

Continuous welding and simultaneous edge sealing of pleated filter media, A. Korz*, K. Herzer, Textile Fusion Technologies GmbH, T. Westermann, Pfaff Industriesysteme und Maschinen AG, Germany I-557

L21 Selective Separation and Classification 16:45-18:00

"Bubble bobble" in the lauter tun – A new way for mash separation in the brewhouse, J. Tippmann*, H. Scheuren, J. Voigt, K. Sommer, Munich University, Germany I-561

Performance of dynamic filtration in particle classification, L. Steinke*, Y. Taamneh, S. Ripperger, University of Kaiserslautern, Germany I-569

Modeling sieving filtration using simple network models, U. Beuscher*, W. L. Gore & Associates Inc., USA I-577

G16 Modelling and Simulation II 16:45-18:00

Influence of an oscillating flow on single fibre efficiency, P. Kopf*, M. Piesche, University of Stuttgart, Germany II-435

Deposition of nanoparticles in the composites of nano- and microsized fibers. The electrostatic effects, L. Gradon*, Warsaw University of Technology, Poland II-443

Effect of slip flow on the pressure drop in fibrous filters, Z. Bin, Tongji University, P.R. China; V. Bertola, The University of Edinburgh, UK; E. Cafaro, P. Tronville*, Politecnico di Torino, Italy II-449

G17 Mist and Droplet Separation 16:45-18:00

Collection of oil droplets from pyrolysis gases by an electrostatic precipitator, A. Bologa*, H.-R. Paur, H. Seifert, K. Woletz, Forschungszentrum Karlsruhe, Germany II-457

Measurements of metal working fluid mist emissions at high concentrations, T. Laminger*, W. Höflinger, Vienna University of Technology, Austria II-465

A model for steady-state oil transport and saturation in a mist filter, D. Kampa*, J. Meyer, B. Mullins, G. Kasper, Karlsruhe University, Germany II-473

The Programme lists countries and regions and is subject to amendments. Errors and obmissions expected.

SESSION CHAIRMEN

TUESDAY, OCTOBER 13, 2009

S1 - Survey Lecture: Advances in Pore Structure Evaluation by Porometry 13:15-14:30 h
Chairman: Harald Anlauf

L1 - Sedimentation Analysis in the Gravity Field 13:15-14:30 h
Chairman: Dietmar Lerche

M1 - Waste Water Treatment 13:15-14:30 h
Chairman: Siegfried Ripperger

G1 - Air Filter I 13:15-14:30 h
Chairman: Thomas Caesar

S2 - Survey Lecture: Membrane Pore Characterization Techniques – Status Quo and Future Development 15:00-16:15 h
Chairman: Richard Wakeman

L2 - Sedimentation Analysis in the Centrifugal Field 15:00-16:15 h
Chairman: Dietmar Lerche

M2 - Produced Water Treatment 15:00-16:15 h
Chairman: Steve Tarleton

G2 - Air Filter II 15:00-16:15 h
Chairman: Thomas Caesar

S3 - Towards predicting filtration and separation - Progress and challenges 16:45-18:00 h
Chairman: Siegfried Ripperger

L3 - Sedimenation and Flotation for Sorting 16:45-18:00 h
Chairman: Harald Anlauf

M3 - Combined Processes 16:45-18:00 h
Chairman: Jaroslav Pridal

G3 - Surface Filtration 16:45-18:00 h
Chairman: Wilhelm Höflinger

WEDNESDAY, OCTOBER 14, 2009

L4 - Sedimentation in Centrifuges/Hydrocyclones 8:30-9:45 h
Chairman: Michael Kopf

L5 - Poster Session I 8:30-9:45 h
Chairman: Graham Rideal

M4 - Poster Session I 8:30-9:45 h
Chairman: Kuo-Lun Tung

G4 - Poster Session I 8:30-9:45 h
Chairman: Gerd Mauschitz

L6 - Filter Media Characterization 11:00-12:15 h
Chairman: Christophe Peuchot

L7 - Cake Filtration Analysis I 11:00-12:15 h
Chairman: Urs Peuker

M5 - Deposition Control 11:00-12:15 h
Chairman: Kuo-Lun Tung

G5 - Industrial Gas Cleaning 11:00-12:15 h
Chairman: Takeshi Yoneda

S4 - Development history and system integration aspects of diesel particle filters in commercial vehicles 13:15-14:30 h
Chairman: Eberhard Schmidt

L8 - Cake Filtration Analysis II 13:15-14:30 h
Chairman: Peter Scales

M6 - Membrane Fouling 13:15-14:30 h
Chairman: Thomas Peters

G6 - Filter Test Systems I 13:15-14:30 h
Chairman: Gerhard Kasper

L17 - Depth Filtration Processes 15:00-16:15 h
Chairman: Hermanes Kleizen

L9 - Cake Filtration Processes I 15:00-16:15 h
Chairman: Gernot Krammer

M7 - Modelling and Simulation 15:00-16:15 h
Chairman: Thomas Peters

G7 - Filter Test Systems II 15:00-16:15 h
Chairman: Gerhard Kasper

L10 - Depth Filtration Analysis I 16:45-18:00 h
Chairman: Hermann Nirschl

L11 - Cake Filtration Processes II 16:45-18:00 h
Chairman: Marja Oja

M8 - Special Membranes 16:45-18:00 h
Chairman: Thomas Peters

G8 - Hot Gas Cleaning 16:45-18:00 h
Chairman: Achim Dittler

THURSDAY, OCTOBER 15, 2009

L12 - Washing of Particles and Cleaning of Media 8:30-9:45 h
Chairman: Urs Peuker

L13 - Poster Session II 8:30-9:45 h
Chairman: Hans Theliander

M9 - Poster Session II 8:30-9:45 h
Chairman: Kuo-Jen Hwang

G9 - Poster Session II 8:30-9:45 h
Chairman: Hans-Joachim Schmid

L14 - Separation Enhancement by Magnetic Forces 11:00-12:15 h
Chairman: Karsten Keller

L15 - Depth Filtration Analysis II 11:00-12:15 h
Chairman: Eugène Vorobiev

G10 - Monitoring and Control 11:00-12:15 h
Chairman: Hans-Joachim Schmid

G11 - Filter Media Clogging 11:00-12:15 h
Chairman: Markus Lehner

L16 - Separation Enhancement by Physical and Chemical Slurry Treatment Chairman: Eiji Iritani 13:15-14:30 h

S5 - Membrane bioreactors in waste water treatment - Status and trends Chairman: Eberhard Schmidt 13:15-14:30 h

G12 - Ab- and Adsorption 13:15-14:30 h
Chairman: Markus Lehner

G13 - Nanofibre Filter Media 13:15-14:30 h
Chairman: Gernot Krammer

L18 - Backwashing Filtration Processes 15:00-16:15 h
Chairman: Martin Lehmann

L19 - Precoat Filtration 15:00-16:15 h
Chairman: Christophe Peuchot

G14 - Modelling and Simulation I 15:00-16:15 h
Chairman: Gernot Krammer

G15 - Special Filter Media 15:00-16:15 h
Chairman: Wallace Leung

L20 - Filter Media Development and Application 16:45-18:00 h
Chairman: Reinhard Bott

L21 - Selective Separation and Classification 16:45-18:00 h
Chairman: Harald Anlauf

G16 - Modelling and Simulation II 16:45-18:00 h
Chairman: Martin Lehmann

G17 - Mist and Droplet Separation 16:45-18:00 h
Chairman: Gerd Mauschitz

FILTRATION PERFORMANCE DOWN TO NANOPARTICLES

Paolo Tronville[1*], R. Vijayakumar[2]
[1] Department of Energetics, Politecnico di Torino, 10129 Turin, Italy
[2] Aerfil LLC, PO Box 41, Liverpool, NY 13088, USA

ABSTRACT

Man-made nanoparticles escaping into the environment and potentially causing adverse health effects are a serious concern for all interested parties. However, safety issues are currently not fully understood and assessed.
We analyze the nanoparticle removal performance of three different wet-laid fibrous filter media used in both general ventilation and contamination control applications. Media characteristics were evaluated experimentally and their performance measured on a small scale test rig in the 0.1-3.0 μm size range. The data were extrapolated down to 10 nm according to the most recent expressions available for Brownian diffusion. The calculations show that the efficiency at 10 nm is clearly higher than the one at 1000 nm and far higher than at MPPS for the three different media considered here.
In the second part of the paper we analyze the peculiarities of fractional efficiency measurements down to particles with size of few nanometers. Special attention is devoted to the phenomena influencing the test rig design and the measurement procedure. We discuss the capabilities and the cost of the instrumentation currently available on the market for measuring the data needed and for widening the particle size range of the most common standardized current test methods.

KEYWORDS

Brownian Motion, Fibrous Filter, Filter Test, Filtration Performance, Fractional Efficiency, Nanofiltration, Nanoparticles, SMPS

1. Introduction

Nanoaerosols are made of engineered nanomaterials, nanoparticles and nanostructures having one or more dimensions of the order of 100 nm or less. There is much interest in nanosized materials because, at the nano-scale, their physical properties are quite different from the properties of the bulk material from which they are made. However, it has been established for many years that exposure to particles, including nanoparticles, can cause illness in individuals or exposed populations.
The potential risks to health from inhalation of nanoparticles are due to several factors.

- Nanoparticles can reach parts of biological systems which are not normally accessible by larger particles, e.g. the possibility of passing directly from the lungs into the blood stream and to all of the organs, or even through deposition in the nose, directly to the brain (translocation).
- Nanoparticles have, for particle collections with equal masses, much higher surface area than larger particles. If surface area is linked to toxicity this implies potentially higher toxic effects.

- The reduction in size has been shown to relate to increased solubility for some nanomaterials. This effect might lead to increased bioavailability of materials which are considered to be insoluble at larger particle sizes.
- Since nanomaterials and nanoparticles have new and different properties from larger particles of the same material, altered chemical and/or physical properties might be expected to be accompanied by altered biological properties, some of which could imply increased toxicity.
- Some high aspect ratio nanoparticles can be inhaled and enter the alveolar region of the lung and are not easily removed. Their physical dimensions inhibit their removal by lung clearance mechanisms and they do not dissolve in the lung fluids. Hence they remain in the lung for a long period of time, causing inflammation and ultimately disease.

The above issues indicate that more needs to be done to assess the potential risks associated with nanomaterials. In the meantime a cautious approach should be taken in their handling and disposal. The risk depends on the dose of the particles in the organ where disease can occur, and the toxicity of nanoparticles. Dose is hard to assess directly, but can be obtained from the exposure to nanoparticles, i.e. the combination of particle concentration in the air which a person breathes in and the duration of the exposure.

If there are no nanoparticles in the air, no dose will accumulate and, despite the potential toxicity of the particles, there will be no risk to health. Therefore in many working atmospheres the preferred method to control risks is a strong effort to mitigate, manage or reduce exposure. Fibrous air filters can be very effective in removing nanoparticles from air streams and may play an essential role in this strategy. However, no standardized test method for measuring the efficiency of filters in removing particles below the 100 nm size is currently available. Test methods for HEPA and ULPA filters measure the removal efficiency corresponding to the most penetrating particle size (MPPS) or close to it, i.e. usually between 100 nm and 200 nm. The most widely used test methods for general ventilation filters supply no data in the defined nanoparticle range, since they test only down to 200 nm (EN779:2002) and to 300 nm (ANSI/ASHRAE 52.2-2007). The absence of references supplying the measured performance of air cleaning devices in removing nanoparticles makes it difficult to draft any regulation for handling nanoparticles safely.

Even if current research shows that the theory of particle removal by fibrous air filters is valid down to 3 nm, it is reasonable to expect that some factual evidence will be requested by regulatory authorities to trust air filters as a valid mean to minimize exposure risks.

The present paper aims at answering the basic question: should the scope of standardized test methods be widened to include the nanometer size range, or is the information obtained with already available test methods enough for nanoparticle exposure assessment?

We divide this problem in two parts. The first one describes the experimental characterization and performance of three wet-laid fiber glass media and the calculated extrapolation of their efficiencies down to 10 nm according to the most recent theory. The second part describes the peculiarities of efficiency measurements down to nanoparticle size, the phenomena influencing test rig design and measurement procedures, and the costs and capabilities of the instrumentation currently available on the market for measuring the data needed.

2. Measurement of filter media properties

Three types (F6, F8 and H13) of media samples were cut from rolls supplied by the manufacturer, using randomized locations down the length and width of the roll. Variances of measured parameters were found to be small, but random sample selection avoids any systematic parameter biases.

More than 20 scanning-electron microscope (SEM) images were taken of each of the three media types. Approximately 1000x magnification allowed the least diameters to be seen and measured, while preserving enough area of the filter media to allow representative sampling. Again, a randomization technique was used to eliminate bias and simultaneously weight the diameters by the length of each diameter interval present. Parallel lines were scratched across the SEM photographs at randomly-located positions. Wherever these lines intersected a fiber, the width of the fiber was measured in the direction normal to the fiber axis. A special scale was prepared to allow rapid sorting of the fiber diameters at each line/fiber intersection. Several hundred intersections (hence fiber diameters) were included from each media type.

Table 1 - Basic parameters of media tested and values obtained from calculations

	Units	Sample Data		
Sample		F6	F8	H13
Rated velocity (v_r)	m/s	0.0617	0.0617	0.0231
Geometric mean diam.(D_g)	µm	4.110	1.561	0.775
Geometric std. dev. (σ_g)	-	1.921	2.141	2.198
Fractional solids (α)	-	0.076	0.081	0.092
Pressure drop (Δp)	Pa	10	42	121
Effective fiber diameter (d_f)	µm	8.179	3.618	1.512
Measured efficiency at 100 nm	%	10.8	44.9	99.3
Measured efficiency at 1000 nm	%	32.0	93.3	99.5
Calculated efficiency at 10 nm	%	81.8	99.2	100
Calculated efficiency at 100 nm	%	23.9	55.4	99.6
Calculated efficiency at 1000 nm	%	20.2	86.9	99.999986

The fiber-size data were fitted to the log-normal distribution to obtain the geometric mean diameter and standard deviation for the fibers in each media.

The (volume) fractional solids in fibrous media is:

$$\alpha = \frac{M_m \left[\frac{\eta}{\rho_{fiber}} + \frac{1-\eta}{\rho_{binder}} \right]}{L} \qquad (1)$$

Fibers of glassfiber filter media have a melting point above the ignition temperature of organic binders. Baking at 500 °C burns the binder out of the media. Weighing media samples before and after baking thus allows the calculation of fiber mass fraction (η). Values of 2450 kg/m^3 for fiber density and 1000 kg/m^3 for binder density were thought reasonable. The thickness of the filter medium was measured, along with the compression function (the relation between the thickness of the medium and the pressure drop across it) using the technique described in Rivers (2000).

The resistance-vs.-velocity characteristics of flat sheets of media were measured in a test duct which exposed an area of media 300 mm by 300 mm. Complete filter cells from these grades of filter media contain enough media area to reduce the average media velocity below 0.1 m/s and hence the expected resistance of a single sheet of medium to very low, difficult-to-measure levels. Accuracy of resistance measurement

was improved by measuring the resistance of a 10-sheet stack. In the range of interest, resistance is essentially proportional to velocity.
Fractional efficiency curves for the three types of media were measured in the same test rig using DEHS synthetic aerosol and an optical particle spectrometer able to provide data in the 100-7500 nm size range.

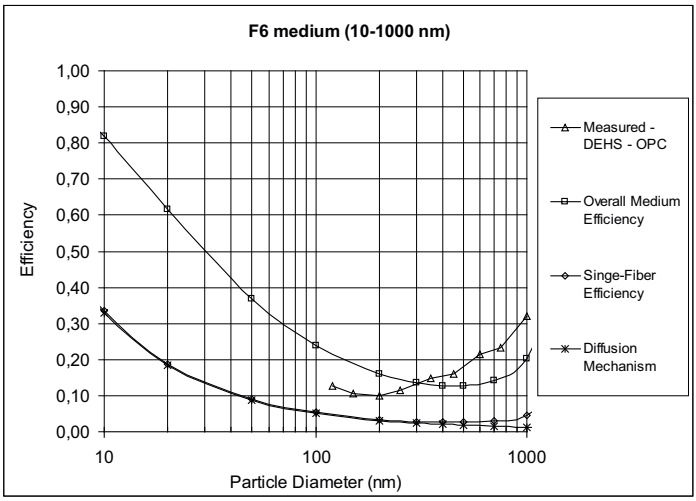

Figure 1 – Fractional efficiency of F6 medium

The single fiber efficiencies due to the deposition mechanisms by which an aerosol particle can be deposited onto a fiber in a filter were computed using the expressions supplied by Hinds (1999). We considered mechanical collection mechanisms only.
The common expression for the diffusion mechanism:

$$E_D = 2 \cdot \frac{1}{\sqrt[3]{Pe^2}} = 2 \cdot \left(\frac{d_f \cdot U_0}{\frac{k \cdot T \cdot C_c}{3\pi \cdot \eta \cdot d_p}} \right)^{-\frac{2}{3}} \qquad (2)$$

was replaced by the more recent expression proposed by Wang (2007):

$$E_D = 0.84 \cdot Pe^{-0.43} \qquad (3)$$

Expression (3) yields a lower efficiency due to the diffusion mechanism than expression (2).
Diffusion is the only important mechanism for particles below 0.2 μm, but is of decreasing importance for particles above that size. It is well known that the competing deposition mechanisms are most effective in different size ranges. Hence all filters have a particle size that gives minimum efficiency, usually in the range from 50 to 500 nm. The single fiber approach takes the distribution of the fiber sizes into account indirectly. Since the flow field and collection efficiency associated with each fiber size are influenced by the presence of fibers of other sizes, as a practical means, the effective fiber diameter d_f, based on pressure drop measurements, is used as an approximation for these calculations. Moreover the fibers may be clumped together and the medium may not be uniform. The use of the effective fiber diameter avoids this problem but it turns out to be very different from the geometric

mean diameter of the log-normal distribution describing the actual physical appearance of the medium itself. The results of the measurements and of the calculations are shown in Figures 1, 2 and 3. Media F6 and F8 are meant for use in general-ventilation applications, while H13 is intended for use in contamination control applications.

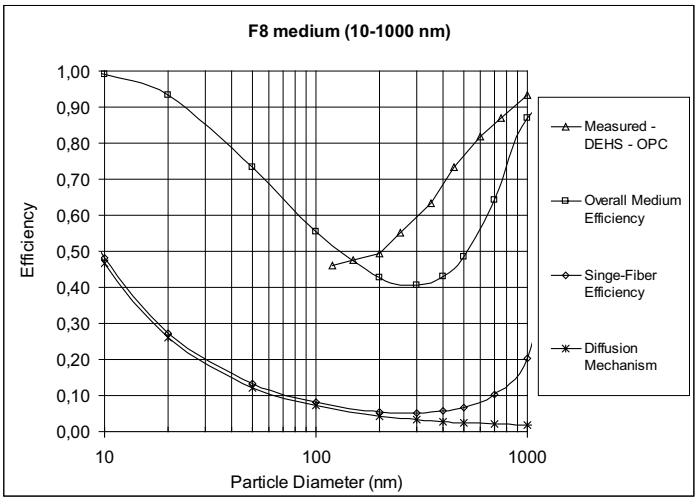

Figure 2 - Fractional efficiency of F8 medium

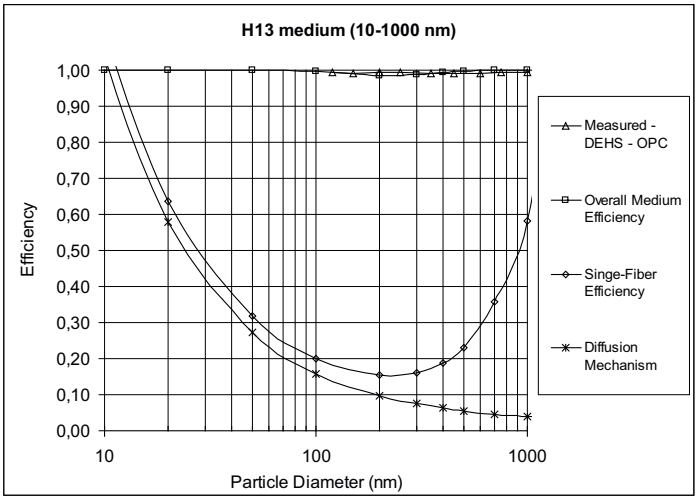

Figure 3 - Fractional efficiency of H13 medium

3. Testing filters at nanometer particle diameters

Current filter testing and standardization practices rely on the higher filter efficiencies predicted at nano-sizes to make claims that filters perform better than specified filter class at nanoparticle sizes. The work reported in this paper has confirmed the predicted higher efficiency at nano-sizes for several filter media. However, building

commercial testing systems for filter performance measurements on nano-size particles poses new challenges. Building commercial test systems involves scaling up the aerosol generating and measurement systems discussed above to handle air flow rates about 1 m^3/s. The general requirements are discussed below.

Particle measurements: Any filter efficiency test system must have the ability to measure concentrations of particles within specific particle size ranges over the entire size range of interest. High quality data requires that the measurement devices have nearly the same response over the range of interest. Even for current measurement systems, measurements over 2 orders of magnitude in particle size and concentration can become a challenge for commercially available measurement devices. When one considers measurements of particles from 5 nm to 10,000 nm, the challenge may become nearly impossible. The use of more than one measurement device may be required to provide data over the entire size range.

Particle size specific concentrations can be measured either by using particle spectrometers or by size classifiers and particle detectors. Current filter test systems mostly use optical particle spectrometers (OPC). These devices provide particle counts in several particle size intervals. Several commercial devices allow users to select the size intervals. Alternately, particles can be classified according to their size and the classified particles counted by detectors. Electrostatic classification of particles and counting by condensation particle counters (CPC) or electrometers are the most common combinations used. In this case, particles are classified according to their electric mobility, which is directly related to particle size. Classification by diffusion is also a technique for particle size specific measurements, although not commonly used. Where one requires measurement for sizes for which calibrated PSL particles are available, it is also common to use these particles without classification.

The advantages of the OPCs are their relatively low cost and their ease of use. Further, most standards relevant to particle contamination and filtration are based on OPC measurements, making data from these devices readily comparable. Their main disadvantage is their detection limitations at smaller sizes. Although the size range of many commercial counters extend down to 100 nm, the response of optical scattering devices drops off significantly for particles under 150 nm. Thus it will be impractical to use these devices for determining filter performance for particles in the sub 100 nm sizes.

Electrostatic classification is the most common method used for particle research and calibration, especially for sub-micrometer particles. Since the size classification can be derived for a given geometry of the instrument, it is also referred to as a reference method. Since the classification is according to the electric mobility of a particle, larger particles carrying multiple units of charge will have double the mobility and, hence, could be classified with singly charged particles with half their size. However, nearly all sub micron particles are singly charged and will be classified according to their size. Commercial electrostatic classifiers account for the effect of multiple charge based on the charge distribution on the aerosol classified. The most common detector for the classified particles is the CPC. Since it can detect nearly all the particles as small as a few nanometers, it is also often called a reference counter. This combination of electrostatic classification and CPC is currently commercially available and is used extensively in nanoparticle research. An alternate means of detecting classified particles is to use an electrometer to collect the particles and measuring the current. Modern electrometers are often more compact and robust than CPCs.

In diffusion classification, penetration of particles through a series of diffusion tubes or screens is measured using a detector, such as the CPC, and the size specific

concentration determined from the data. Although diffusion classification does not depend on the charge on the particle, since particles of all sizes will penetrate to different extent through the diffusion element, the classified aerosol is somewhat poly-disperse. Hence these measurements require extensive data reduction to generate particle size specific concentration. Perhaps for this reason they are not in common use outside of particle research.

Further, as discussed earlier, the efficiency of even lower grades of media can be quite high for nano-size particles. Hence, the downstream counts for these particle sizes will be quite low for many filters, requiring long sample times to obtain statistically valid counts with any of the devices discussed above. Since time is invaluable in product manufacturing, instruments with large sample flows may be needed for nanoparticle measurements.

Particle Losses: Loss of particles during sampling and transport is always a concern since such losses can introduce unknown errors in the data. In current filter testing practice, the focus has been primarily on large particles, typically greater than 2000 nm. Since large particles are lost in sharp bends in tubing, valves, and constrictions, current testing system designs minimize these elements in sampling lines. Where practical, sample lines upstream and downstream of filters are made equal in length in an attempt to equalize the losses, if any, and minimize errors in the computation of filter efficiency. Smaller particles are considered to behave like gases and their losses are generally ignored. However, the losses due to Brownian Diffusion increase significantly for nano-sizes. Much like the higher capture efficiency for nanoparticles in filters, nanoparticles are also more readily “captured” in the sample lines. Hence nanoparticle sampling will require more attention to making upstream and downstream sample lines exactly equal. In addition, a two-stage sampling may be needed if the instrument sample flow rate is low, as is common in many CPCs. In this case, a first stage sample is taken at a high sample flow rate, minimizing the residence time and hence the losses in the sample lines. Then the detection instrument with its much smaller flow rate can sample from this larger first stage sample using very short sampling tubes.

Challenge Particles: The common practice of using poly-dispersed aerosols with particle spectrometers or classifiers will be adequate, in principle, for measurements at nano-sizes. However, as noted above, because of the higher filter efficiency for nanoparticles, poly-disperse aerosols with large concentrations in the nano-sizes are preferred. Vapor condensation generators are best suited for this purpose and are commercially available. Alternately, atomizing solutions of the aerosol material and flashing the solvent will yield a large concentration of poly-dispersed nanoparticles of the solute material. This technique is used in the ASHRAE 52.2 standard for generating nano-size KCl aerosol for neutralizing electrostatic charge in filters.

Other factors: In general, all other good testing practices described in many of the national standards are readily applicable for testing filters down to nano-sizes. These include prescription for system validation, dilution of upstream concentrations, and aerosol neutralization as well as general system configuration.

In summary, the established practices prescribed by the prevailing standards offer a good starting point for testing filter efficiency for nanoparticles. Additional precautions in sampling and measurements are required to obtain valid results. The main upgrade for these systems will be the particle measurement devices, and the design of the sample lines to minimize losses. Further, the need for statistically valid counts may require longer and more expensive testing times. Overall, it is our opinion, based on current market for these particle instruments, that filter efficiency measurements for nanoparticles will add over 30% to the cost of the system.

Conclusions

Our analysis suggests that the additional cost for extending the measuring range down to a few nanometers is not fully justified by the further data obtainable in this way. However, the calculated efficiency depends on many parameters and the accurate characterization of filter media is rather difficult and time consuming. At the same time the technology for evaluating the performance of air filters down to a few nanometers is available on the market and reasonably priced. Interested parties may be willing to pursue efficiency measurements down to a few nanometers, following the nature of air filtration which is mainly experimental.

Acknowledgements

The authors are indebted to Silvano Caon (Politecnico di Torino) and Emanuele Costa (Università di Torino) for the experimental data characterizing the filter media considered in this study.

References

1. Brown R. C., *Air filtration*, Pergamon Press, Oxford, 1993.
2. British Standards, "PD 6699-2:2007 Nanotechnologies – Part 2: Guide to safe handling and disposal of manufactured nanomaterials", London, 2007.
3. Balazy A., Podgorski A., Gradon L., "Filtration of nanosized aerosol particles in fibrous filters. I – experimental results", J. Aerosol Science, EAC Proceedings, Vol. II, p. S967–S980, 2004.
4. Gradon L., Podgórski A., Balazy A., "Filtration of nanoparticles in the nanofibrous filters", Filtech 2005, Wiesbaden, 11-13 October 2005, Vol. II, p.178-185.
5. Heim M., Mullins B., Wild M., Meyer J., Kasper G., "Filtration efficiency of aerosol particles below 20 Nanometers", Aerosol Science and Technology, v. 39, p. 782–789, 2005.
6. Hinds W. C., *Aerosol Technology: Properties, Behavior and Measurement of Airborne Particles*, John Wiley & Sons, New York, 1999
7. Japuntich D.A., Franklin L.M., Pui D.Y.H., Kuehn T.H., Kim S.C., Viner A.S., "A Comparison of two nano-sized particle air filtration tests in the diameter range of 10 to 400 nanometers", J. Nanoparticle Research, v. 9, p. 93-107, 2007.
8. Kim S.C., Harrington M., Pui D.Y.H., "Experimental Study of Nanoparticle Penetration through Commercial Filter Media", J. Nanoparticle Research, v. 9, p. 117-125, 2007.
9. Rivers, R. D., Murphy D. J., "Air Filter Performance Under Variable Air Volume Conditions", ASHRAE Transactions, 106(2), pp. 131-144, 2000.
10. Wang J., Chen D.R., Pui D.Y.H., "Modeling of Filtration Efficiency of Nanoparticles in Standard Filter Media", J. Nanoparticle Research, v. 9, p. 109-115, 2007.